

Administrative Order 04-04

Pursuant to Ordinance no. 03-33, as amended by Ordinance no. 04-11, I hereby make the following interpretation and/or technical correction to Herriman City's Development Standards, Engineering Requirements and Supplemental Specifications for Public Works Projects:

Design Requirements Section 4


- Any underground connections or where connections are exposed to the weather Contractor shall use DBY connectors.
- Any buried bolts shall be greased and wrapped.
- All pressure reducing valves shall be epoxy coated.
- Contractor shall provide full meter enclosure (NEMA 4x Stainless Steel) for all components that require electrical service. Power shall be fully connected to structure / component and all equipment therein shall be fully functional.
- Vaults shall be ventilated according to CW-12.

Standard Plans CW-01: PVC meter barrel is no longer allowed – use white HDPE.

Standard Plans SW-01: Schedule 40 1" PVC may be used as conduit between meter boxes.

DATED this 23rd day of February, 2005.

CITY OF HERRIMAN

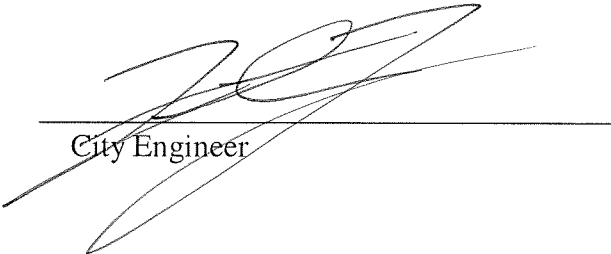

City Engineer

JNBHMS95